



**Test item particulars .....**

Tested lamp .....: LED  
 Tested lamp system .....: N/A

**Lamp classification group.....: Exempt Group**

Lamp cap .....: N/A  
 Bulb.....: N/A  
 Rated of the lamp .....: N/A  
 Furthermore marking on the lamp.....: N.A.  
 Seasoning of lamps according EN standard .....: No seasoning  
 Used measurement instrument.....: See appendix B for details  
 Temperature by measurement.....: 25.0°C  
 Information for safety use.....: N.A

**Possible test case verdicts:**

- test case does not apply to the test object.....:N(.A.)
- test object does meet the requirement.....:P(ass)
- test object does not meet the requirement.....:F(ail)

**General remarks:**

The test results presented in this report relate only to the object tested.  
 This report shall not be reproduced, except in full, without the written approval of the Issuing testing laboratory.  
 "(See Enclosure #)" refers to additional information appended to the report.  
 "(See appended table)" refers to a table appended to the report.  
 Throughout this report a point is used as the decimal separator.  
 List of test equipment must be kept on file and available for review.


**Remark:**

This report consists of 17 pages and following appendixes:  
 Appendix A EUT photos  
 Appendix B Difference Declaration  
 Appendix C Test equipment list








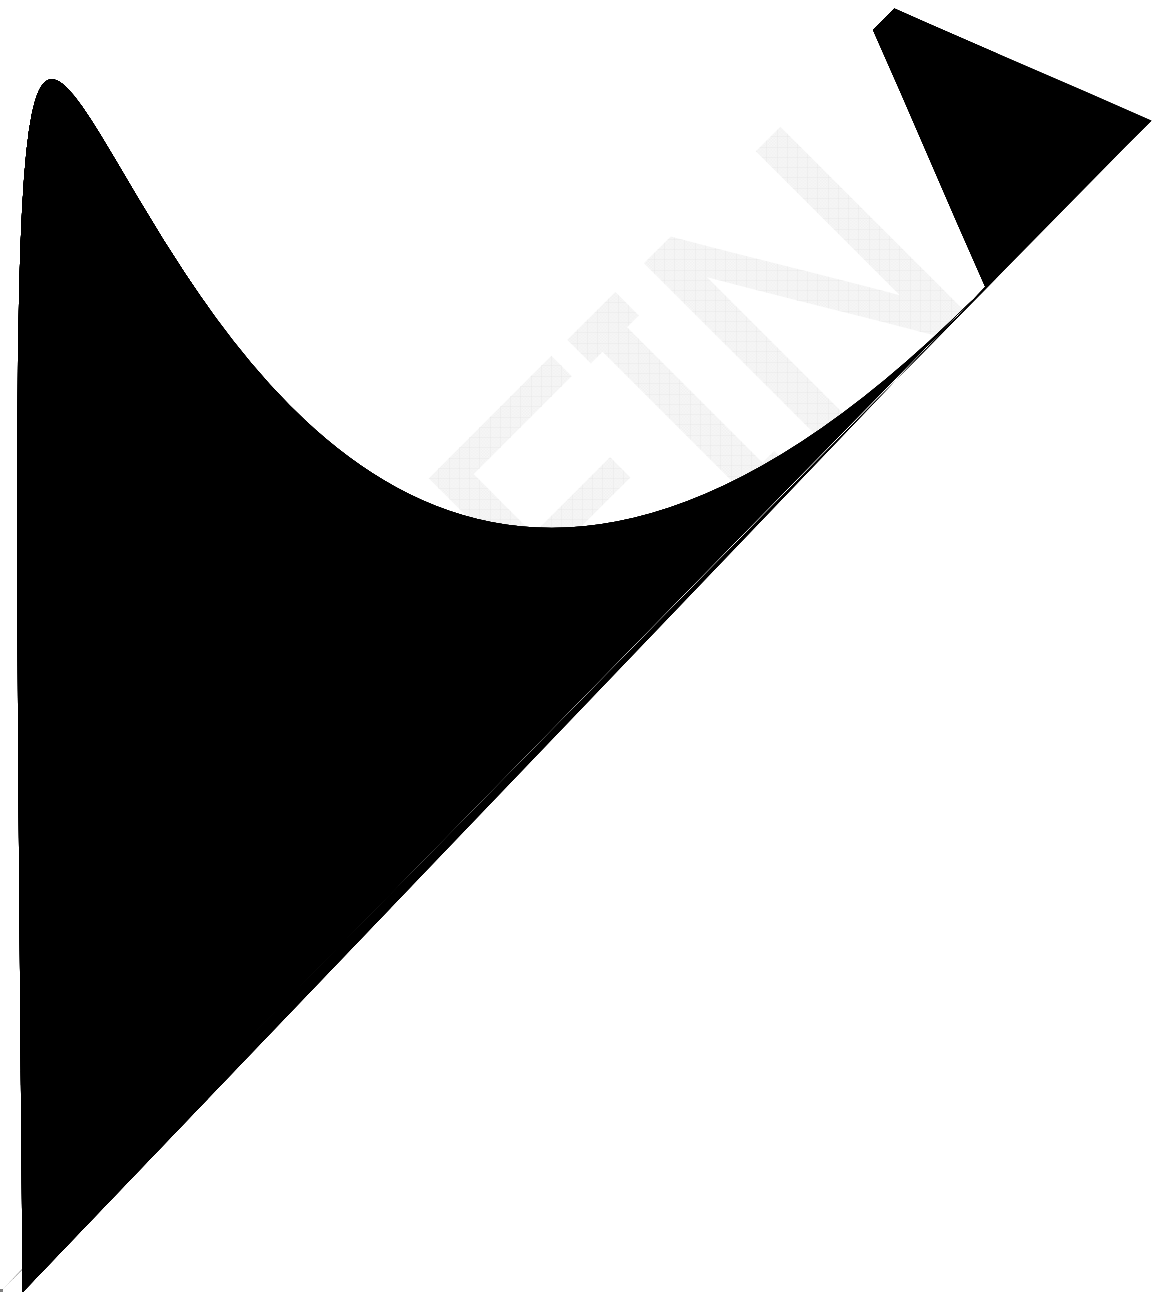







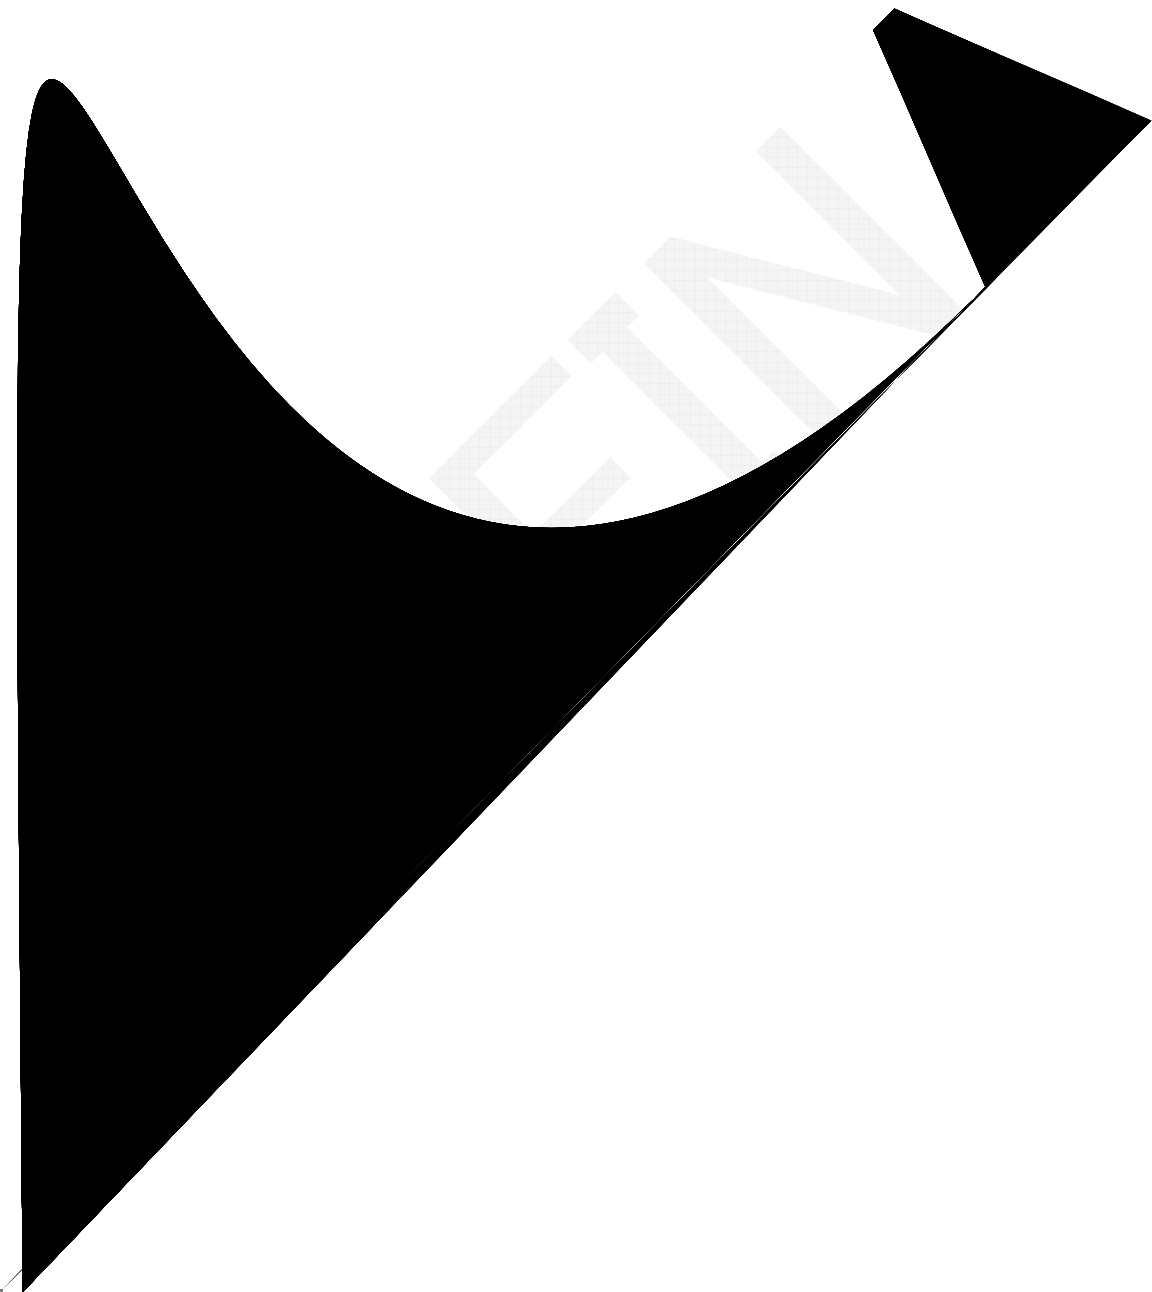






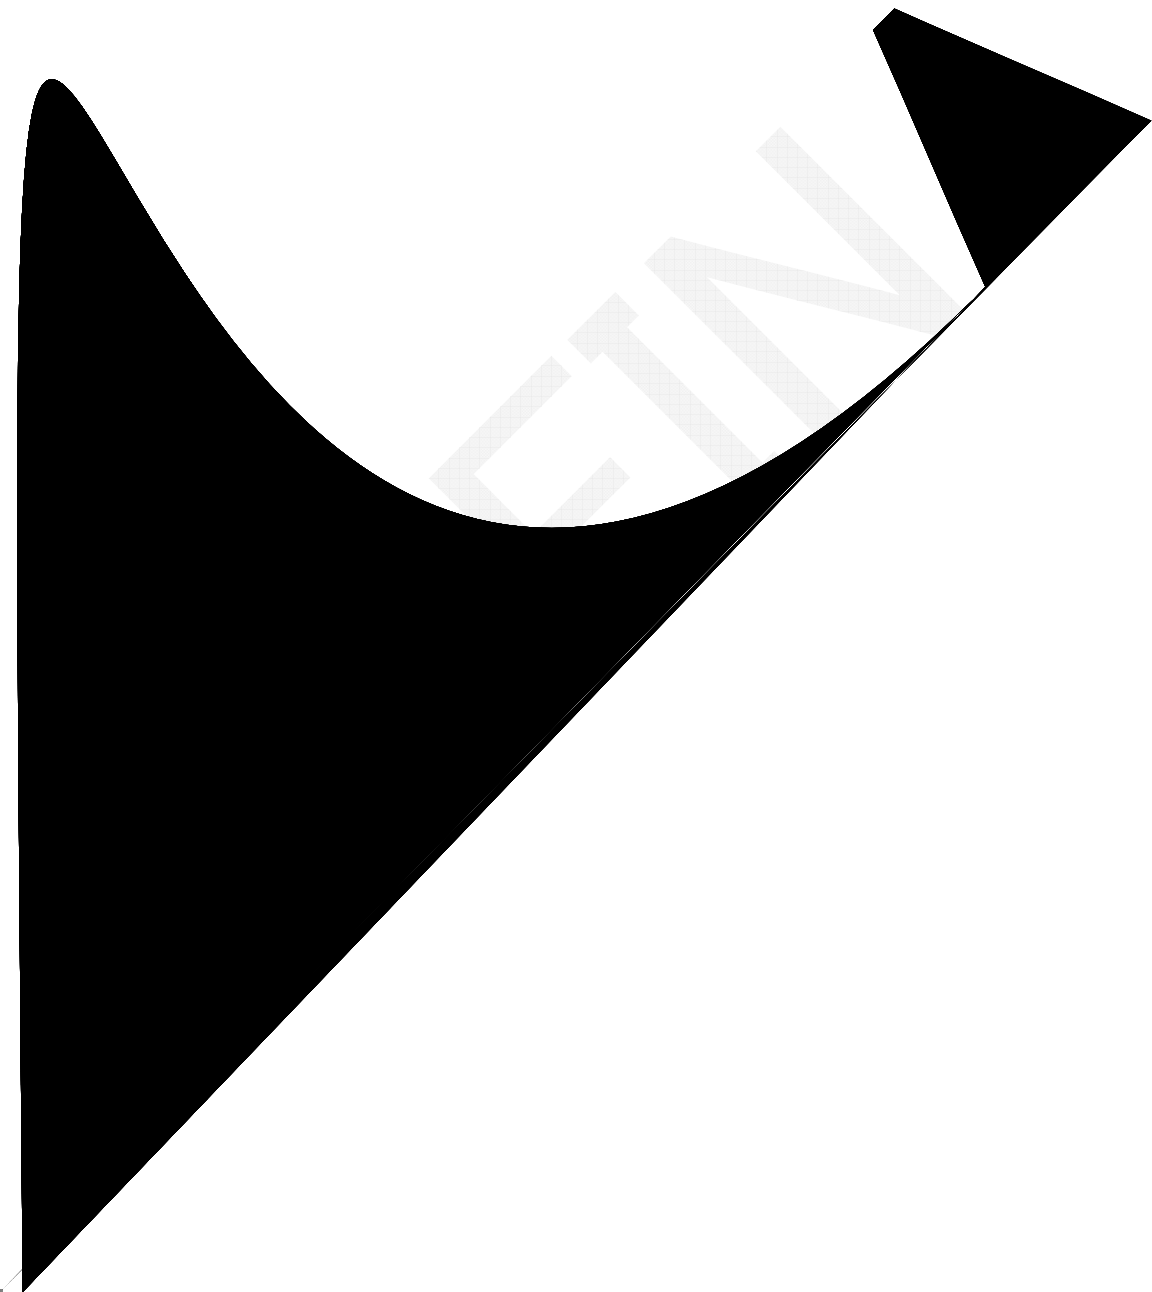





Figure of Spectral distribution



Appendix A - EUT Photos  
The front view of EUT

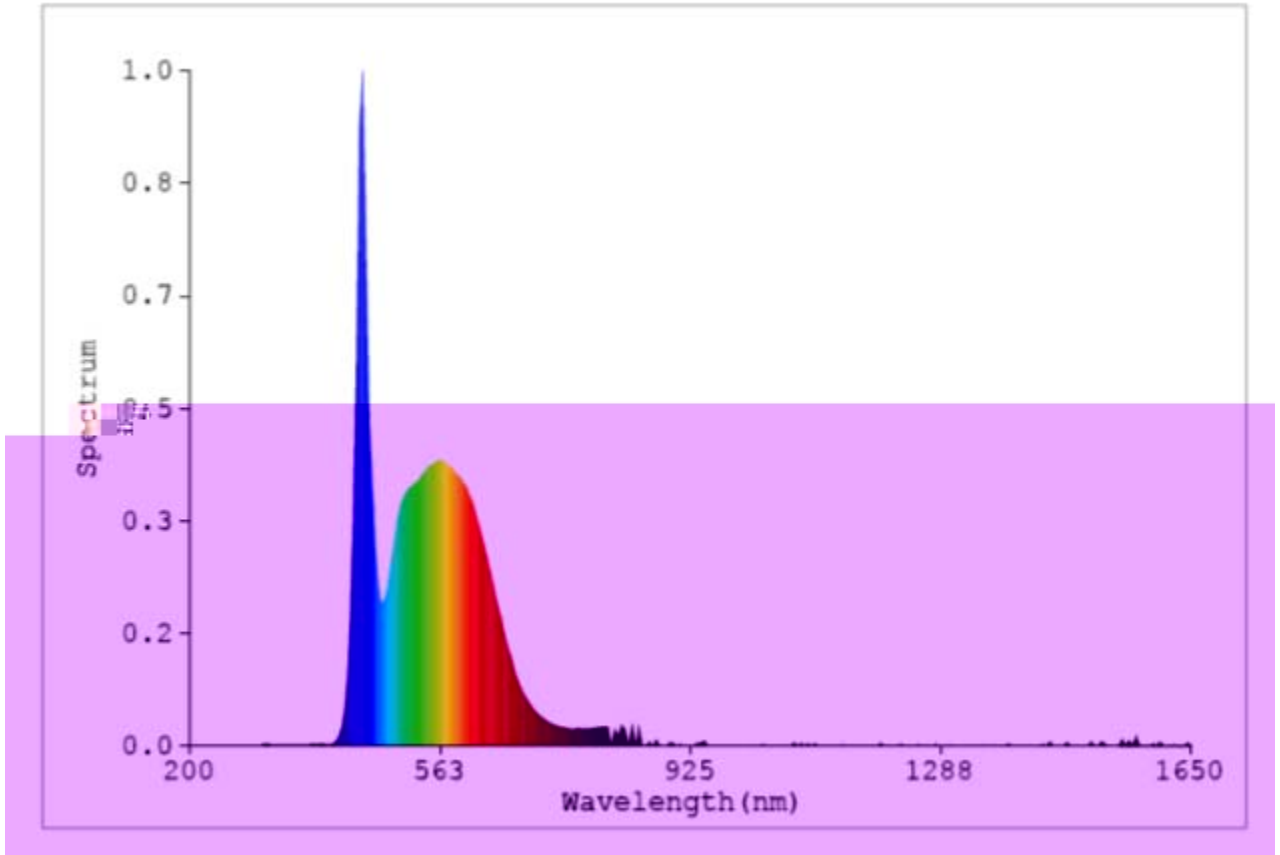

The back view of EUT

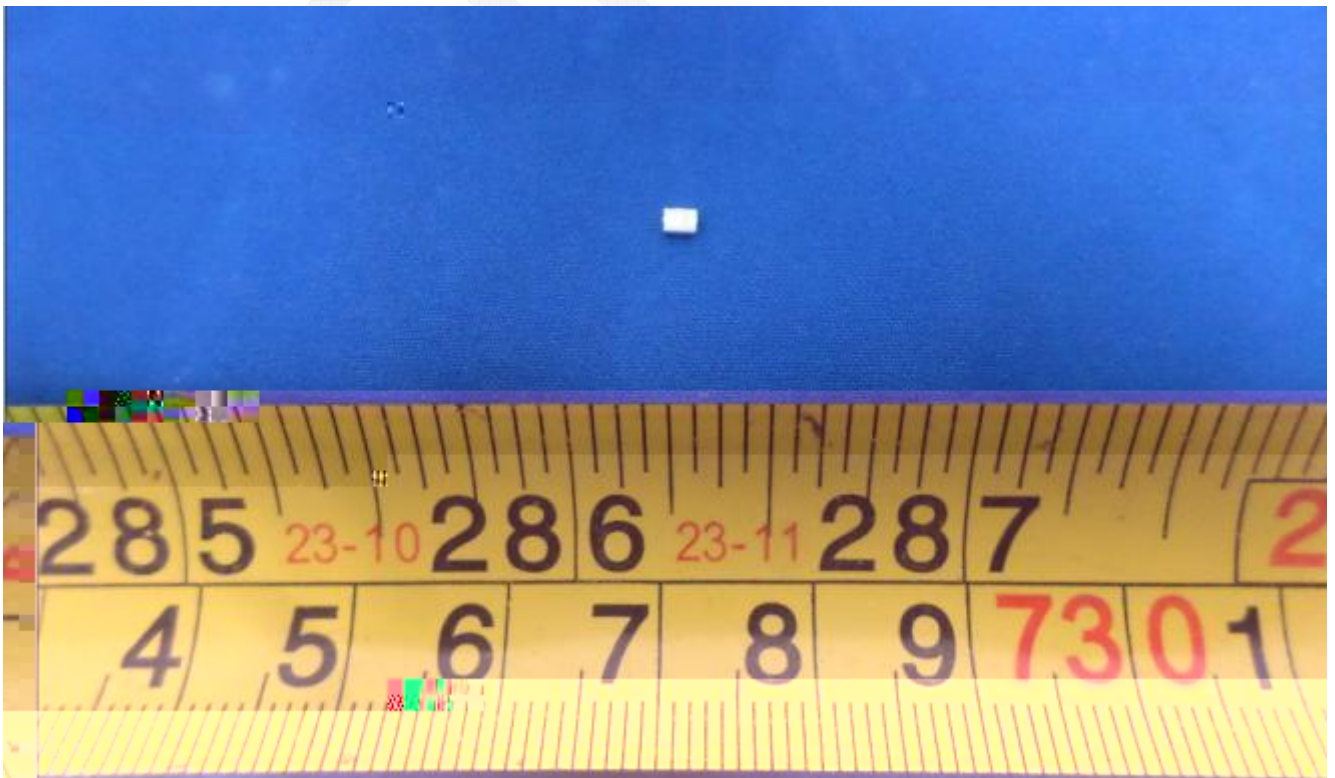

## Appendix B Difference Declaration



## Difference Declaration

We, Guangzhou Hongli Opto-Electronic Co.,Ltd., hereby declare that





### Appendix C Test equipment list

Equipment Description	Model No	BACL#	Manufacturer	Last Cal	Cal Due
UV light leakage spectrum of biological safety systems	PMS-300	T-08-EE042	EVERFINE	2015-03-25	2016-03-24
Standard power spectral UV radiation-specific	UVS-8003	T-08-EE048	EVERFINE	2015-03-25	2016-03-24
80mm sample integrating sphere	SMS-300	T-08-EE055	EVERFINE	2015-03-25	2016-03-24
Radio meter	RD-2000	T-08-EE056	EVERFINE	2015-03-25	2016-03-24
high-accuracy digital photometer head	HAAS-2000	T-08-EE058	EVERFINE	2015-03-25	2016-03-24
Hygrothermograph	PWS280	T-08-QA026	N/A	2015-03-24	2016-03-23
Steel tape	HILOCK-19	T-08-SF100	TAJIMA	2013-04-18	2018-04-17

\*\*\*END OF REPORT\*\*\*